

# PLAN SUBMITTAL CHECKLIST

## GILA COUNTY COMMUNITY DEVELOPMENT

(To be used as a guide for meeting minimum plan submittal requirements)

### **GENERAL REQUIREMENTS**

- Drawn to Scale @  $\frac{1}{4}''=1'-0''$  Min.
- 18" x 24" Minimum or 24" x 36" Maximum
- 2 Sets Residential (including 2 copies of Site Plan) or 2 Sets Commercial-more if applicable
- Notes should be on the page they pertain to (i.e.: foundation-related notes on foundation plan, etc.)
- Steel structures must be engineered and calcs submitted with plans
- Structures with openings within 4' of corners may require lateral shear analysis (Engineering)

### **SITE PLAN** at $1''=20'$ scale min. on 8 $\frac{1}{2}''$ x 11" paper (if possible) showing:

- North arrow
- Dimensioned lot lines
- Setback lines with dimensions to property lines
- Dimensioned easements and alleys
- Locations and dimensions of all existing and proposed structures (including fences)
- Distances between all existing and proposed buildings on the property
- Distances from all existing and proposed buildings to property lines
- Locations and widths of driveways
- Location of all washes, ditches, creeks and drainage easements
- Location of all cuts and fills
- Locations of all existing and proposed utilities including:
  - Utility lines and underground piping
  - Water/electric/gas meters
  - septic tank, leach field and reserve area
  - well
  - LPG tank (indicate capacity and whether above or below ground - below ground installations require State Fire Marshal Approval).

### **EXTERIOR ELEVATIONS** at $\frac{1}{4}''=1'$ scale min. showing:

- Exterior finishes and materials
- Roof pitches
- Building heights
- Actual grade depicted

### **FOUNDATION PLAN** at $\frac{1}{4}''=1'$ scale min. showing:

- Concrete strength
- Lines and dimensions indicating locations and width of footings, stem walls, slabs & landings

### **And Foundation Details** at $\frac{3}{4}''=1'$ scale min. showing:

- Keyed to the Foundation Plan
- Reinforcing steel – size, spacing, and location
- Size and depth of footings
- Retaining wall design information (Engineering required-pre-engineered handout available)

### **FLOOR PLAN** at $\frac{1}{4}''=1'$ scale min. showing:

- Rooms and space usage
- Locations and sizes of doors and windows
- Locations and sizes of headers/beams
- Locations of plumbing fixtures
- Locations of heating and cooling equipment and distribution layout (specify if gas or electric)
- Total square footage of living area, storage, patios, carports

**NOTE: If electrical, plumbing, and/or mechanical systems are not able to be represented sufficiently on floor plan, a separate plan will be required.**

**TYPICAL BUILDING SECTION** at 3/8"=1' scale min. showing:

- Footing, floor, wall, ceiling and roof construction
- Location, type and size of required connectors/tie-downs/bracing/reinforcement

**And Details** at 3/4"=1' scale min. showing:

- Any construction/connections not clearly shown on stairway section

**FLOOR FRAMING PLAN** at 1/4"=1' scale min showing:

- Size, type and grade of framing material
- Spacing and direction of span of floor framing members
- Size, type and span of girders and lintels
- Pre-fab trusses and I joists to be submitted with calcs
- Location, type and size of required connectors/tie-downs/bracing

**ROOF FRAMING PLAN** at 1/4"=1' scale min. showing:

- Size, type, and grade of framing materials
- Spacing and direction of span of roof framing members
- Size, type and span of headers, beams, and lintels
- Prefab trusses and I Joists to submitted with calcs.
- Location, type and size of required connectors/tie-downs/bracing

**MASONRY FIREPLACE SECTION** at 3/8"=1' scale min. showing:

- Size and type of materials used
- Footings, wall, firebox, flue, hearth and chimney construction
- Location, size and type of reinforcement

**And Details** at 3/4"=1' scale min. showing

- Any construction/connections not clearly shown on Fireplace section

**STAIRWAY SECTION** at 3/8"=1' scale min. showing:

- Actual section of proposed stairway
- Dimensions of rise and run
- Dimensions of landing(s)
- Number of risers and treads
- Railing size and height
- Width of stairway
- Use and construction of under-stair area

**And Details** at 3/4"=1' scale min. showing:

- Any construction/connections not clearly shown on stairway section

**SPECIFICATIONS/MANUFACTURER'S INSTALLATION STANDARDS MUST BE PROVIDED FOR:**

- Any proposed materials or methods not addressed in the Uniform Building Code
- All appliances (to be provided on job-site)



**ADDITIONS AND REMODELS:** Plans must show:

- Floor plan and room/space usage of existing use adjacent to proposed use
- Size/type/depth of load bearing members and foundations in existing structure that support any portion of proposed work

**NOTE:** these requirements list the minimum information needed for plan review. This information can be provided in any order or in any manner as long as it clearly shows what is proposed.

745 N Rose Mofford Way, Globe, Arizona 85501  
Phone: 928-425-3231 Ext 4224 or 8513, Fax 928-425-0829  
608 E. Highway 260, Payson, Arizona 85541  
Phone: 928-474-9276, Fax 928-474-0802

# SAMPLE ONLY

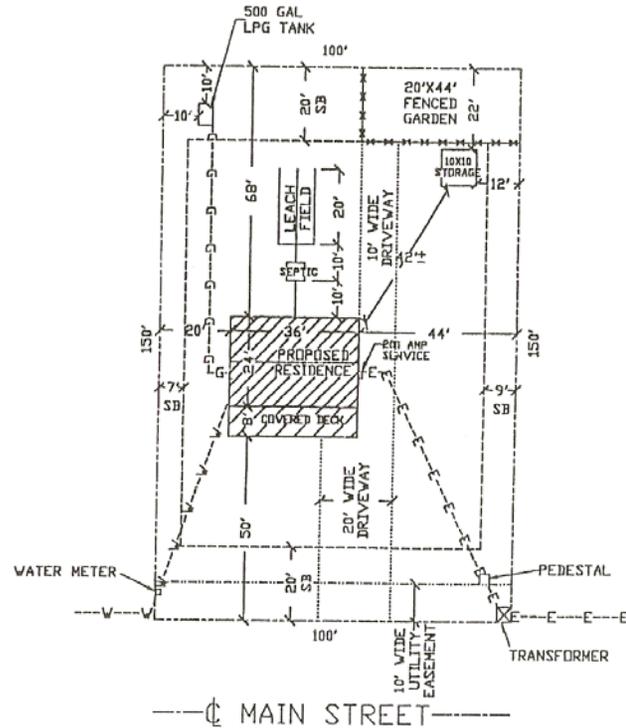

## GENERAL NOTES

1. APPROVED PLANS AND PERMITS TO REMAIN ON JOBSITE UNTIL PASSING FINAL INSPECTION.
2. ADDRESS TO BE VISIBLE AND LEGIBLE FROM STREET.

ADOPTED CODES: 1991 UBC, UPC, AND UMC  
1990 NEC.

## SITE PLAN

SCALE: 1" = 20'


## SITE PLAN

SCALE: 1" = 20'

DATE: APRIL 10, 2000

SHEET 1 OF 9

# SAMPLE ONLY

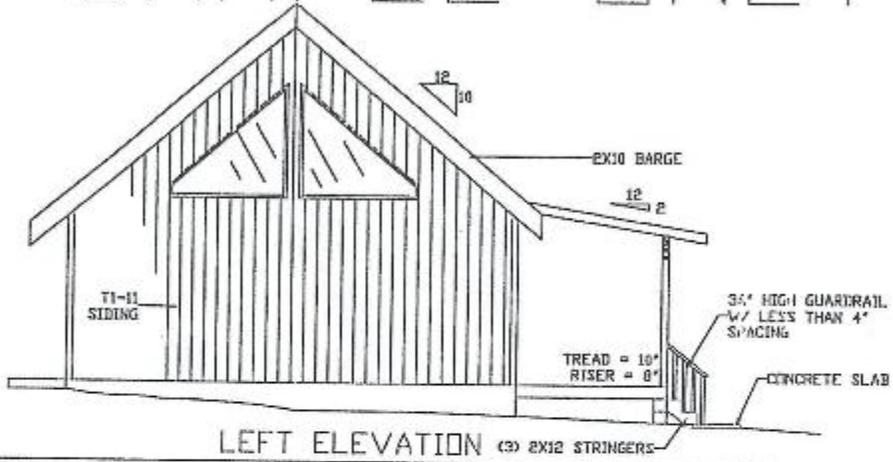

LEFT ELEVATION

SCALE: 1/4" = 1'-0"



FRONT ELEVATION

SCALE: 1/4" = 1'-0"



## FRONT & LEFT ELEVATIONS

SCALE: 1/4" = 1'-0"

DATE: APRIL 10, 2000





SHEET 2 OF 9

# SAMPLE ONLY

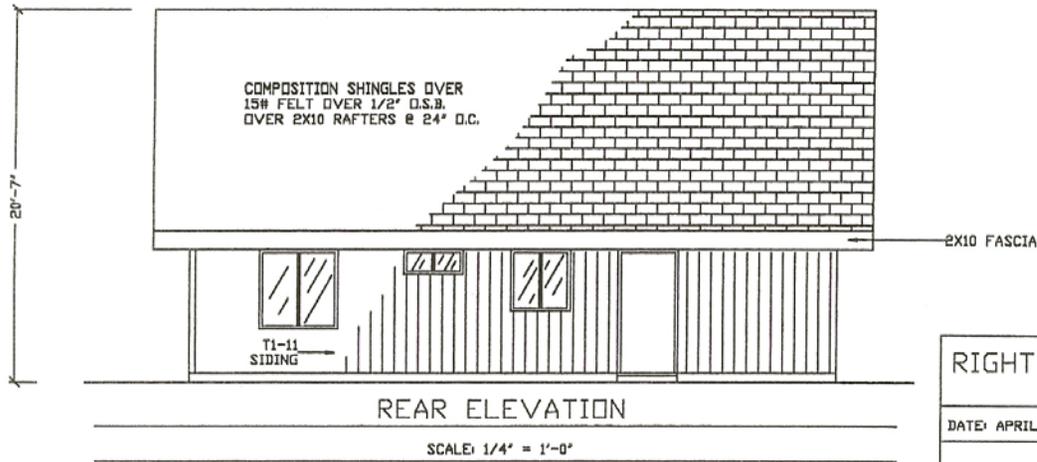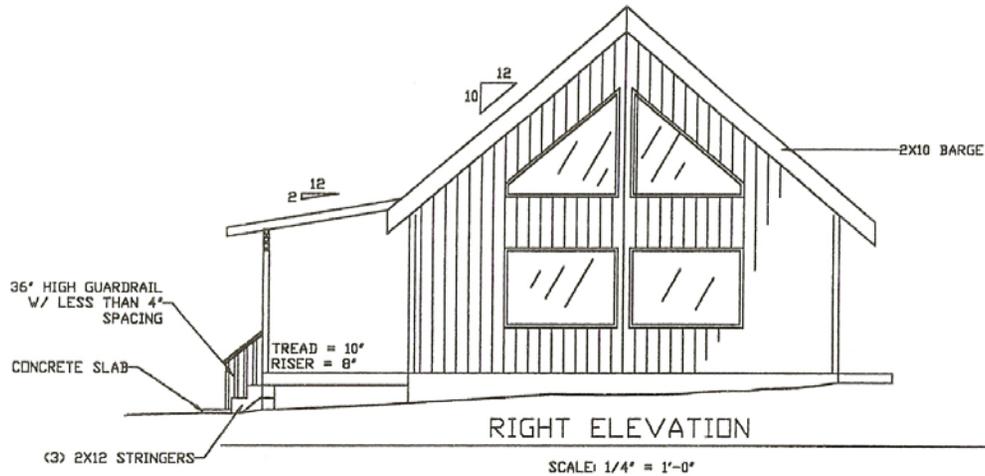



RIGHT & REAR ELEVATIONS	
SCALE: 1/4" = 1'-0"	
DATE: APRIL 10 2000	
	SHEET 3 OF 9

# SAMPLE ONLY

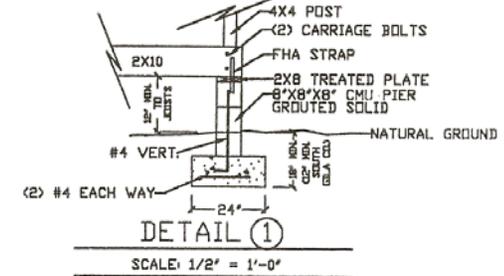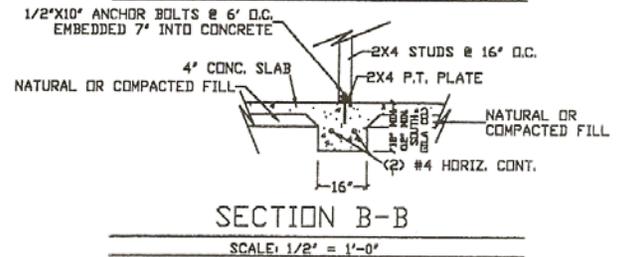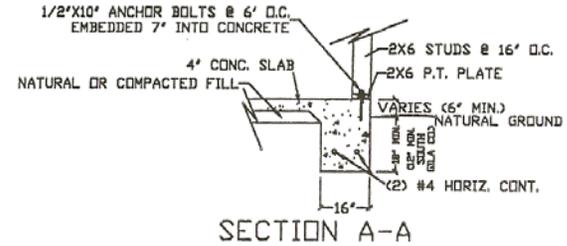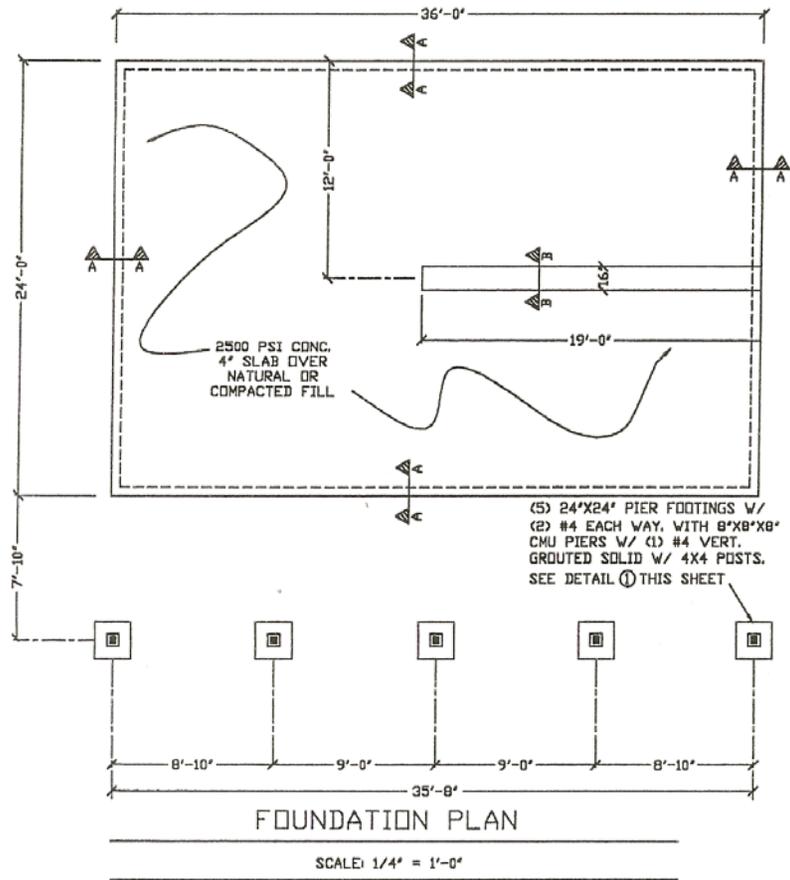

<b>FOUNDATION PLAN</b>	
SCALE: 1/4" = 1'-0"	
DATE: APRIL 10, 2000	
	SHEET 4 OF 9


# SAMPLE ONLY

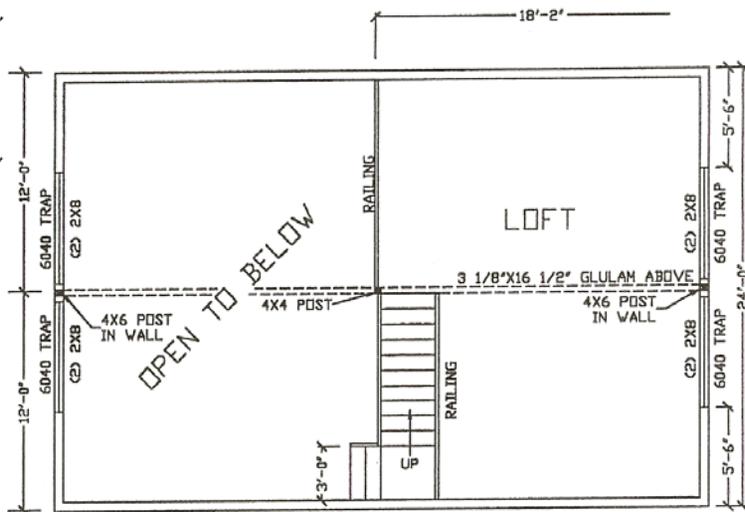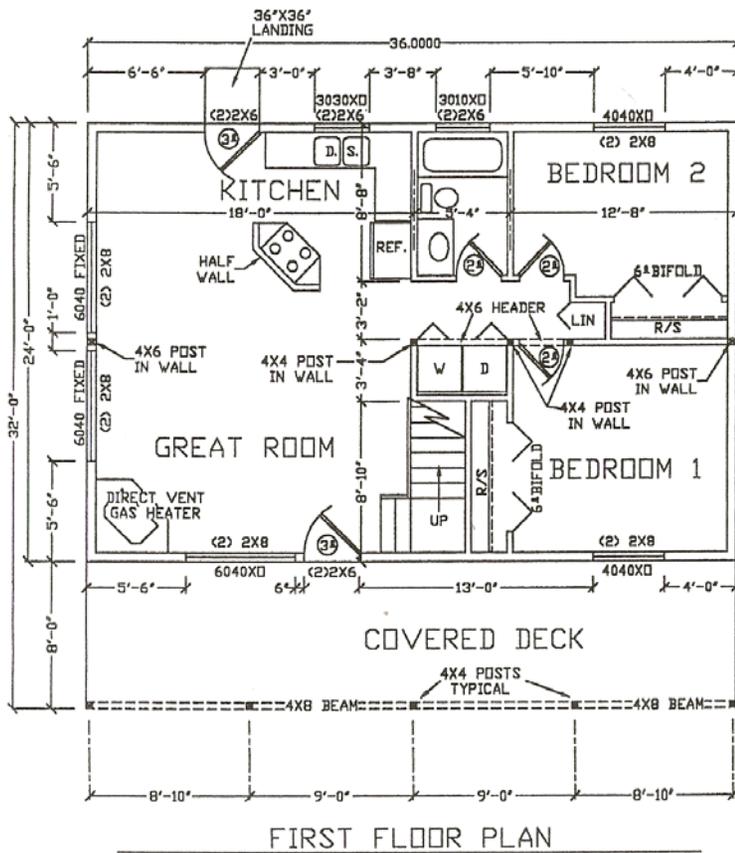

SECOND FLOOR PLAN  
SCALE: 1/4" = 1'-0"

<b>FLOOR PLAN</b>	
SCALE: 1/4" = 1'-0"	
DATE: APRIL 10 2000	
	SHEET 5 OF 9

# SAMPLE ONLY

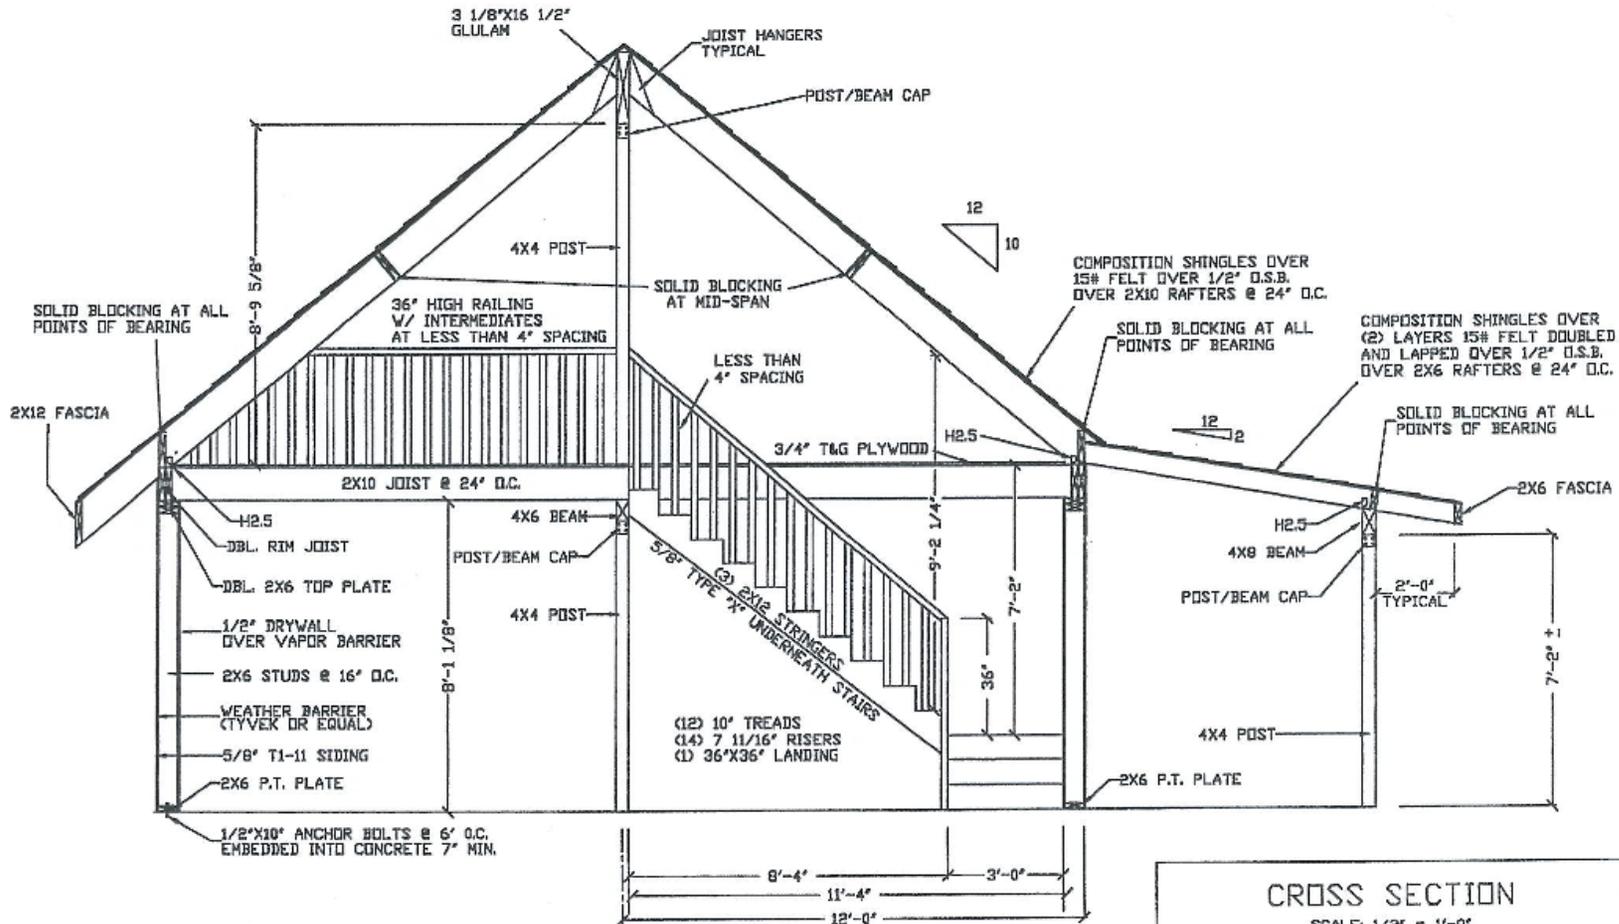

CROSS SECTION

SCALE: 1/2" = 1'-0"


## CROSS SECTION

SCALE: 1/2" = 1'-0"

DATE: APRIL 10, 2000

SHEET 6 OF 9

# SAMPLE ONLY

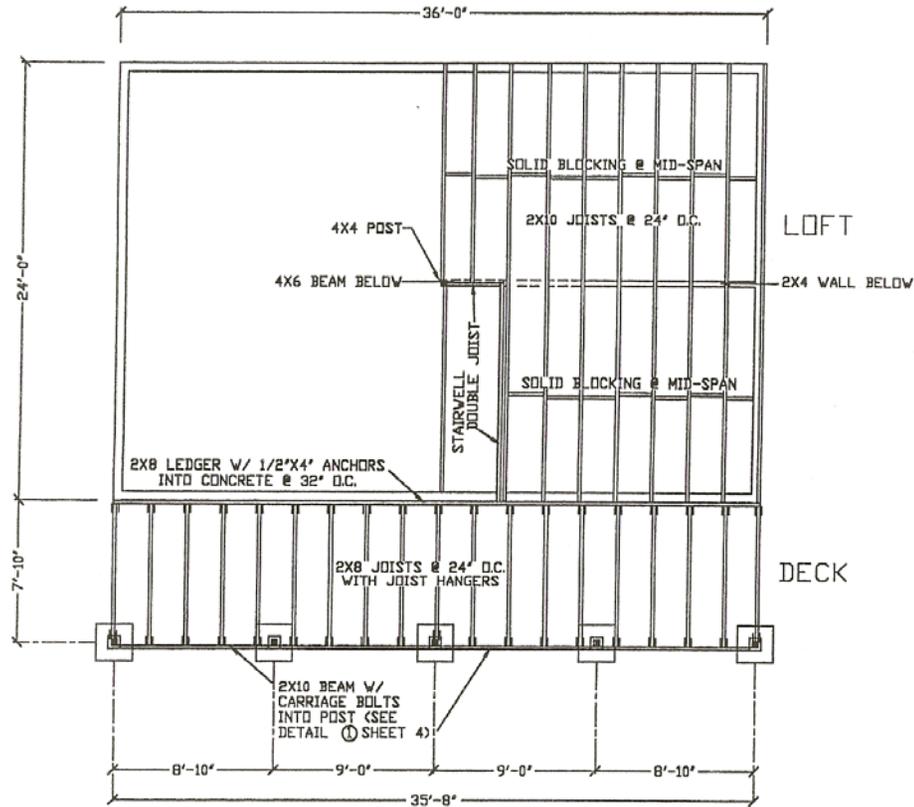

## LOFT FRAMING AND DECK FRAMING

SCALE: 1/4" = 1'-0"


## LOFT FRAMING AND DECK FRAMING

SCALE: 1/4" = 1'-0"

DATE: APRIL 10, 2000

SHEET 7 OF 9

# SAMPLE ONLY

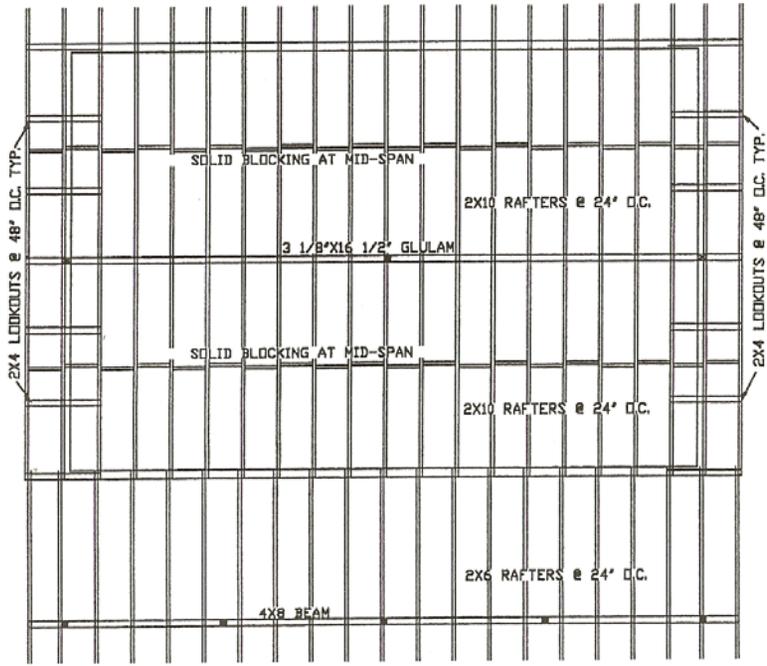

ROOF FRAMING PLAN


SCALE: 1/4" = 1'-0"

ROOF FRAMING PLAN	
SCALE: 1/4" = 1'-0"	
DATE: APRIL 10, 2000	
SHEET 8 OF 9	

# SAMPLE ONLY


## ELECTRICAL NOTES

1. SMOKE DETECTORS ARE 120V INTERCONNECTED WITH BATTERY BACK-UP. INSTALL WITHIN 12" OF PEAK OF VAULTED CEILING.
2. INSTALLATION SPECS FOR ALL APPLIANCES TO BE AVAILABLE ON JOBSITE.
3. FIXTURES TO BE ATTACHED TO BEAM MUST BE SURFACE MOUNTED. CUTTING OR DRILLING INTO BEAM REQUIRES ENGINEERING.
4. VENT DRYER TO OUTSIDE.
5. WATER HEATERS ARE \*INSTANT\* UNITS LOCATED AT SINK AND LAV. PRESSURE/TEMPERATURE RELIEF VALVE MUST TERMINATE OUTSIDE.

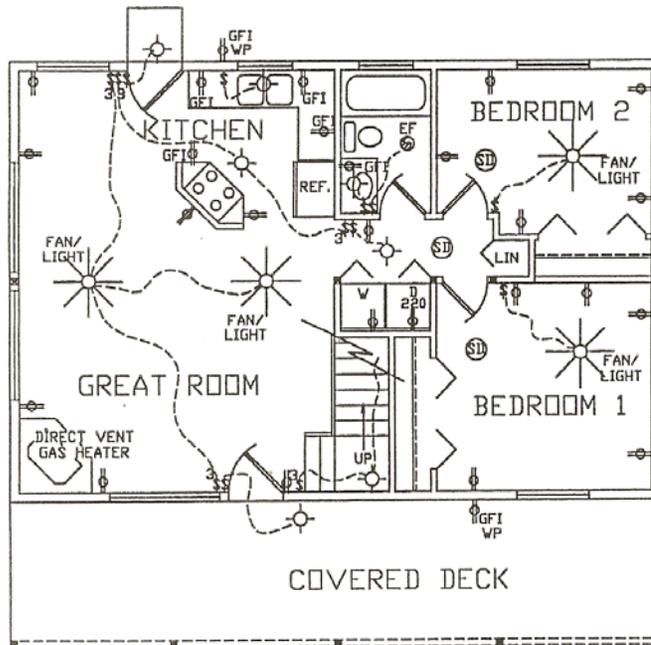

FIRST FLOOR ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

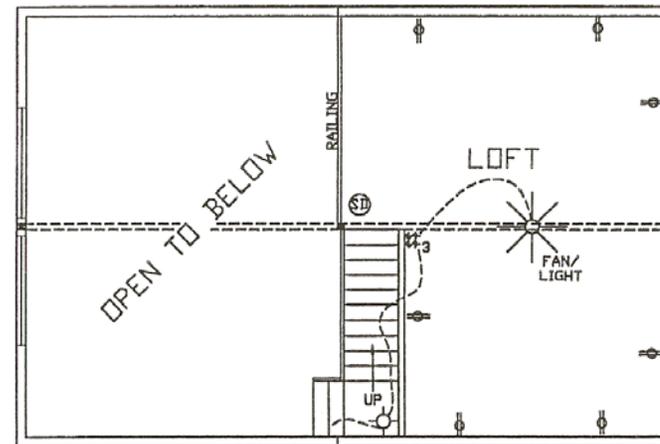

SECOND FLOOR ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

## ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

DATE: APRIL 10, 2000

SHEET 9 OF 9

## **DESIGNERS REVIEW REQUIRED PRIOR TO SUBMITTAL**

Due to the discrepancies between submitted drawings and pre-engineered products (trusses, floor and roof systems), all designers are required to review and approve engineered project submittals as consistent with their design, prior to submittal to Gila County.

Typical problems are being encountered with bearing support beam sizing, foundation sizing, header sizing, uplift connections and resistance design/selection of mechanical connectors required.

Failure to have designer review engineered product submittals and properly coordinate design drawings, prior to submittal to Gila County, will result in a delay in review and permitting of your project. Additional fees may be incurred if multiple reviews are required due to these discrepancies.

## **ENGINEERING REQUIRED**

If the design has pre-engineered roof and floor systems above that do not bear directly on standard foundation walls with a uniform load, an engineered foundation is required. Engineer must review and approve pre-engineered product layout and calcs. Engineer must provide foundation calculations and stamped drawings.

If concentrated loads, greater than 5,000#, exist at any bearing location (wall or spread footing), and/or transfer of loads is required (via beams, girder trusses, headers, etc.) an engineered beam calcs and foundation is required. Engineer to provide calculations and stamped drawings.

If your design exceeds prescriptive code requirements, an engineered shear / lateral design is required. Engineer to provide complete calculations, diagram and stamped drawings.